



Physical inclusion
Sensory inclusion
Cognitive inclusion

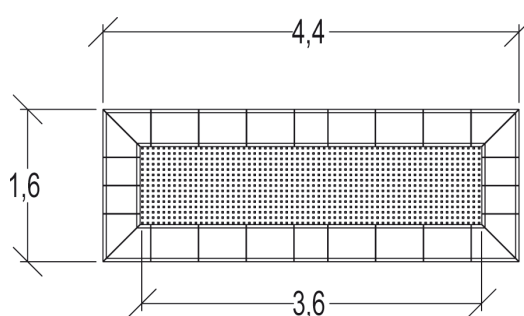

The space above the trampoline must be free from any obstacle up to a height of 3.50 metres, measured from the bounce surface. Manual wheelchairs only.

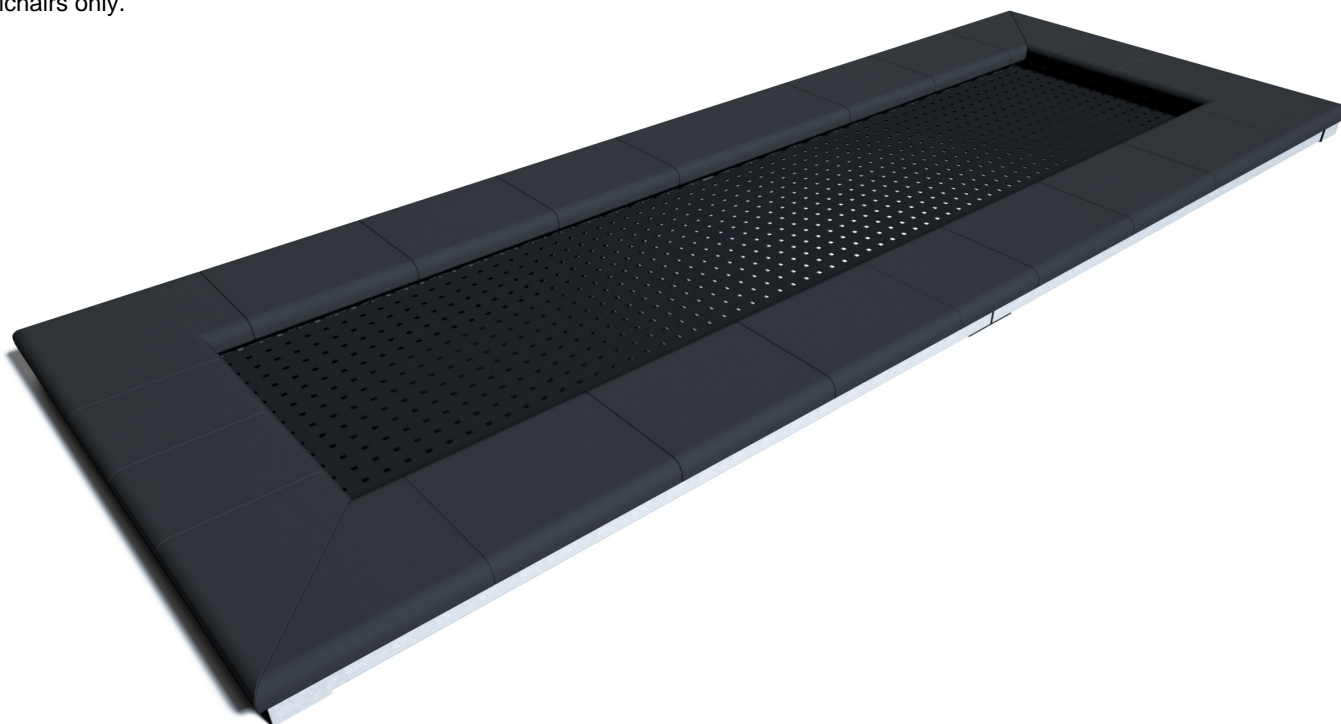

Play value : **2**

meeting



x1

balancing






x1

Installation of equipment

IMPORTANT: It is essential to refer to the installation instructions for information on the size of the safety areas.

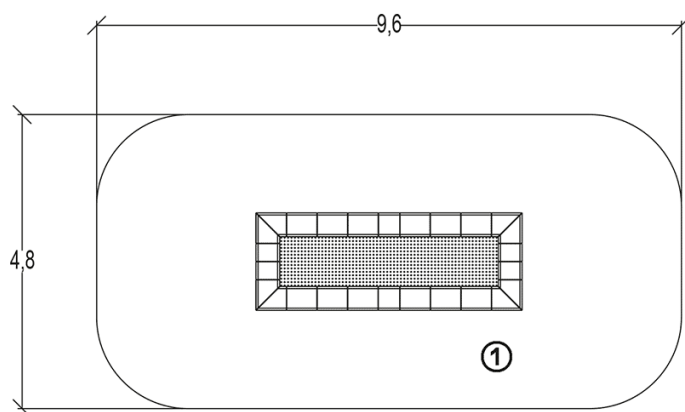———— Impact area (minimum normative surface)
- - - - Free space



		
1	1m	44,2m ²



0

0m³

44.2m²

350kg

-

EN
1176