



Physical inclusion
Sensory inclusion
Cognitive inclusion

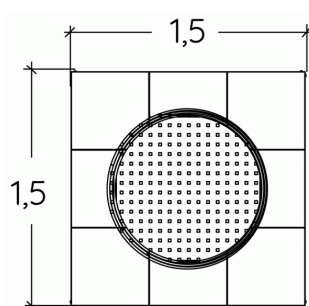

The space above the trampoline must be free from any obstacle up to a height of 3.50 metres, measured from the bounce surface. Manual wheelchairs only.

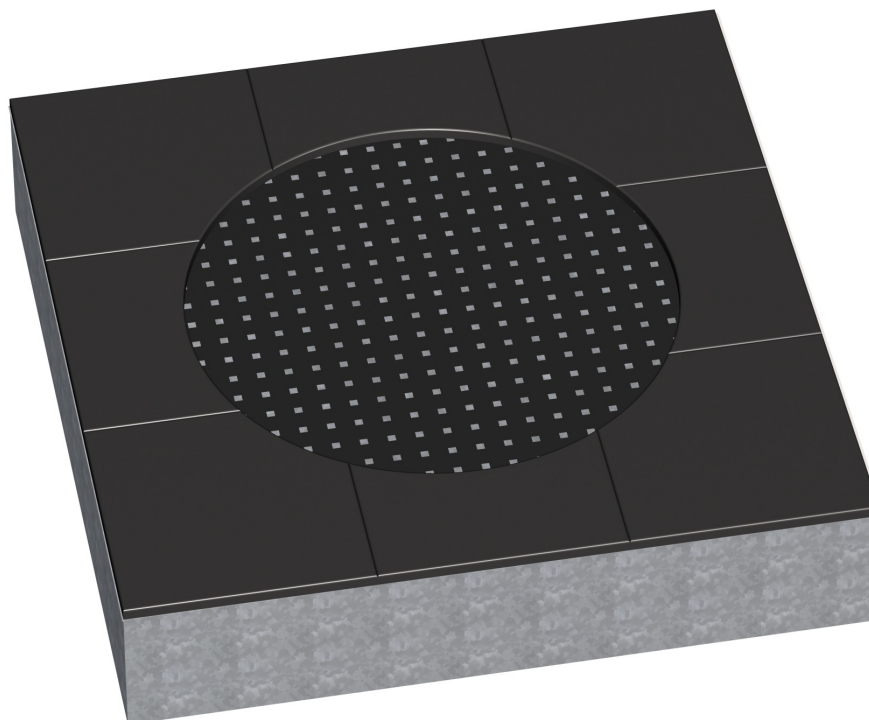

Play value : 2

meeting



x1

balancing






x1

Installation of equipment

IMPORTANT: It is essential to refer to the installation instructions for information on the size of the safety areas.

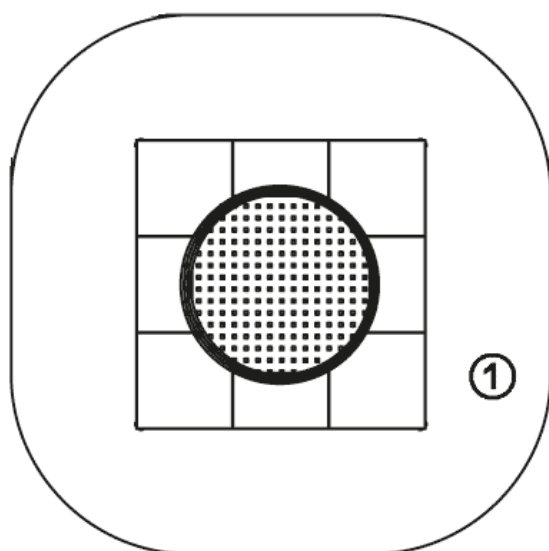— Impact area (minimum normative surface)
- - - Free space



		
1	1m	14m ²



0



02h30



0m³



14m²



170kg



-

