



The space above the trampoline must be free from any obstacle up to a height of 3.50 metres, measured from the bounce surface. Manual wheelchairs only.



**Play value :** **2**

meeting

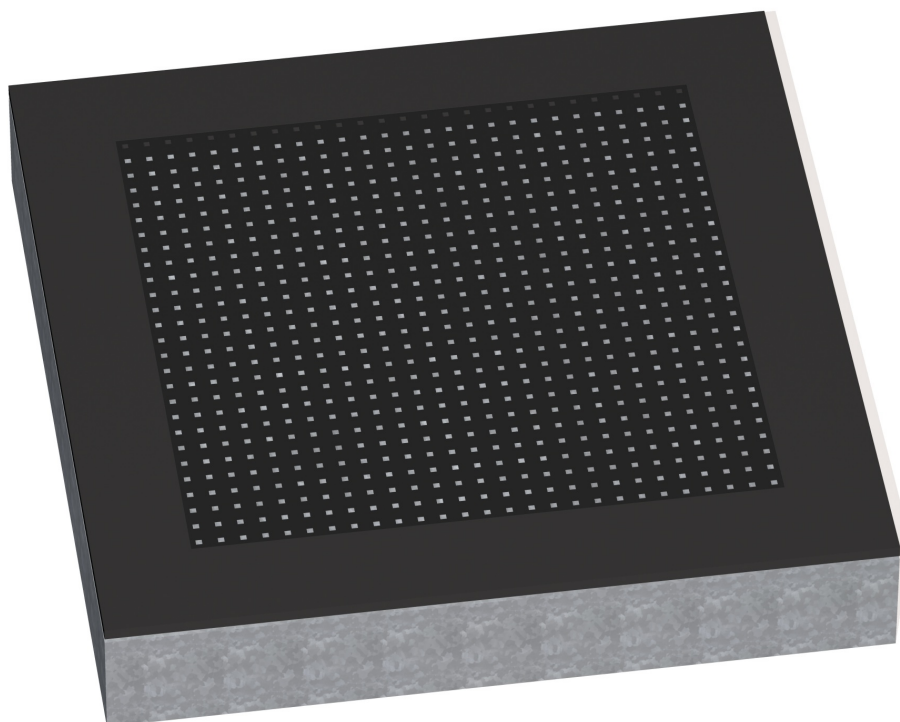

x1

balancing




x1



## Installation of equipment

**IMPORTANT:** It is essential to refer to the installation instructions for information on the size of the safety areas.

— Impact area (minimum normative surface)

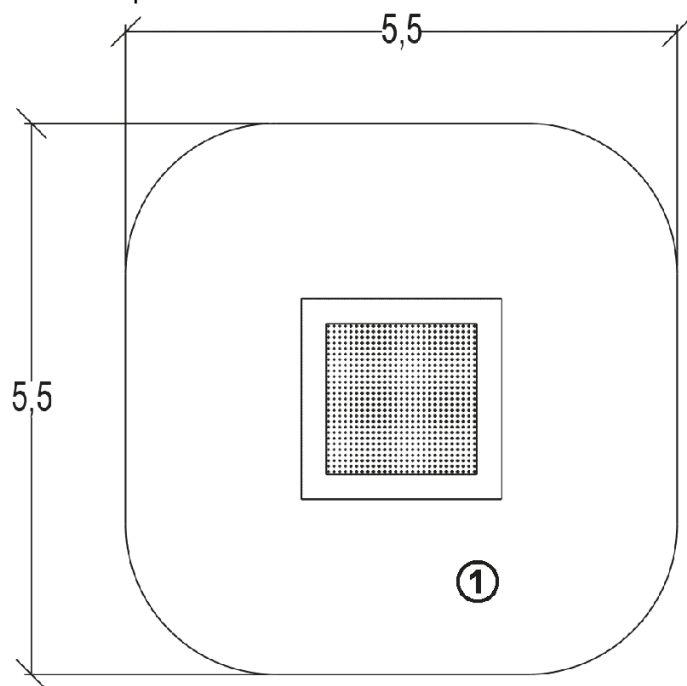- - - Free space



		
1	1m	24,5m <sup>2</sup>



2



01h50



0m<sup>3</sup>



24.5m<sup>2</sup>



225kg



-

EN

1176